

HeRAMS

Snapshot: Status of Public Hospitals in the Syrian Arab Republic

June 2015

This is to acknowledge that the data provided in this snapshot is a product of joint collaboration between the World Health Organization, Ministry of Health, and Ministry of Higher Education in the Syrian Arab Republic. The report covers the month of June 2015.

Contents:

This document provides a snapshot of the status of public hospitals under the Ministries of Health and Higher Education, as of June 30, 2015 in terms of functionality, accessibility, and level of damage.

1. Completeness of Reporting


The completeness of reporting from public hospitals across Syria remained at 100%, where all the 99 Ministry of Health (MoH) Hospitals and the 14 Ministry of Higher Education (MoHE) hospitals continued to report to HeRAMS in June 2015.

2. Functionality Status


Functionality of the public hospitals has been assessed at three levels: fully functioning, partially functioning, and not functioning.

By the end of June 2015, and out of the **113** assessed public hospitals [MoH & MoHE], 41% (46) were reported fully functioning, 32% (36) hospitals were reported partially functioning (i.e., shortage of staff, equipment, medicines or damage of the building in some cases), while 27% (31) were reported non-functioning [Figure 1].

Distribution of public hospitals by functionality status is presented in Map 1.

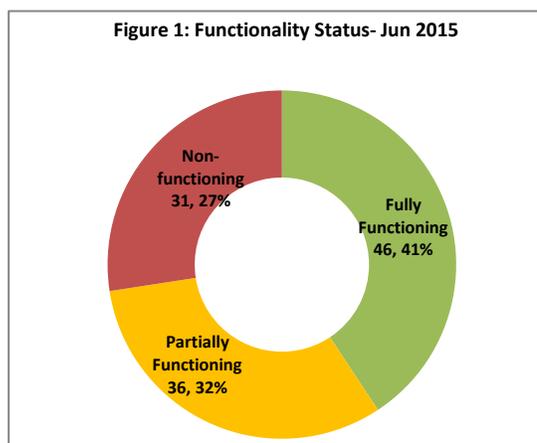

Map 1: Distribution and functionality status of the public hospitals [MoH & MoHE], June 2015

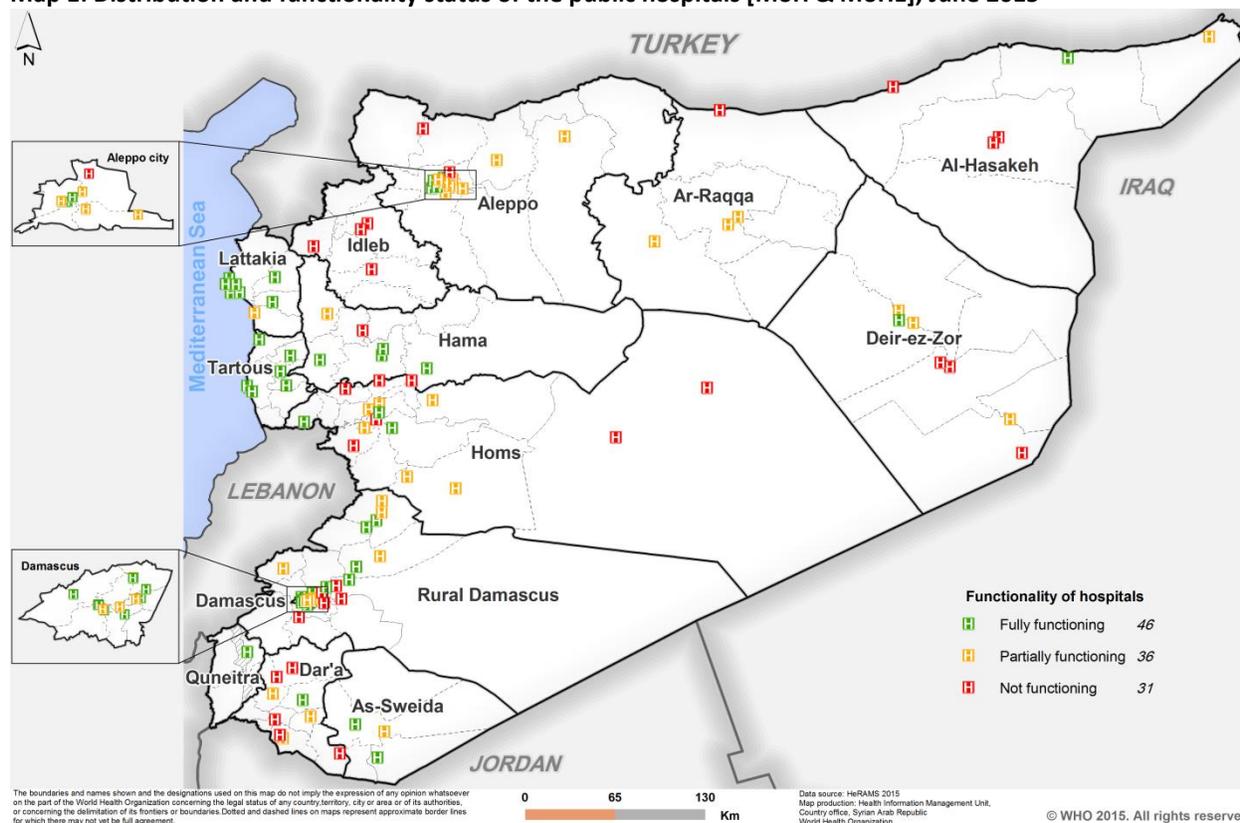


Since beginning of the year, June 2015 was the worst month with regards to functionality of the hospitals, 31 hospitals were reported out of service compared to 19 in January 2015 [Figure 2].

The increase of the number of non-functioning hospitals in June 2015 is an indication for the direct impact of the deteriorating security situation in Ar-Raqqa governorate (i.e., Tal Abyad hospital becomes

non-functional], Al-Hasakeh governorate [i.e., two hospitals become non-functional: Al-Hasakeh national hospital, and the Children hospital, during the last 10 days of June].

Figure 2: Trend analysis of functionality status, between January and June 2015

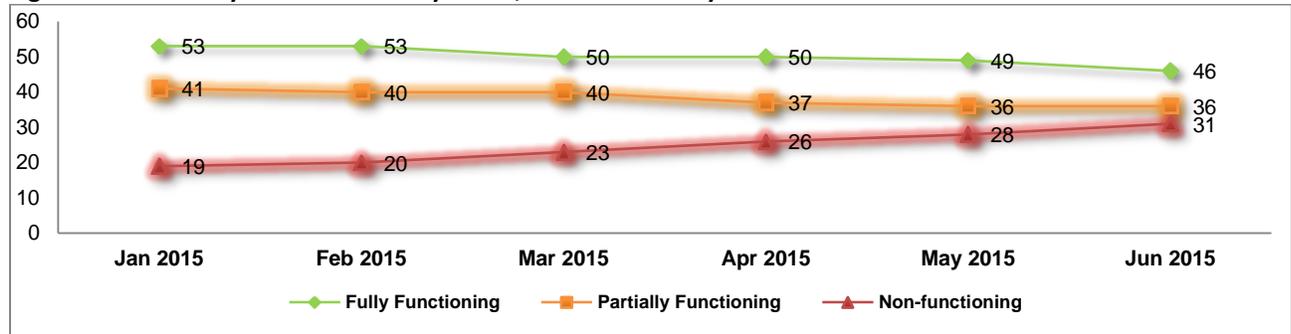


3. Accessibility Status


Accessibility to public hospitals has been assessed at three levels: accessible, hard-to-access, or inaccessible hospital for patients.

By the end of June 2015, 59% (67) hospitals were reported accessible, 17% (19) hard-to-access, and 24% (27) were inaccessible [Figure 3]. Distribution of public hospitals by accessibility status is presented in Map 2. The number of inaccessible hospitals increased from 24 by end of May to 27 by end of June (those are Tal Abyad hospital in Ar-Raqqa governorate, Al-Hasakeh national hospital, and the Children hospital in Al-Hasakeh governorate).

Figure 3: Accessibility status- Jun 2015

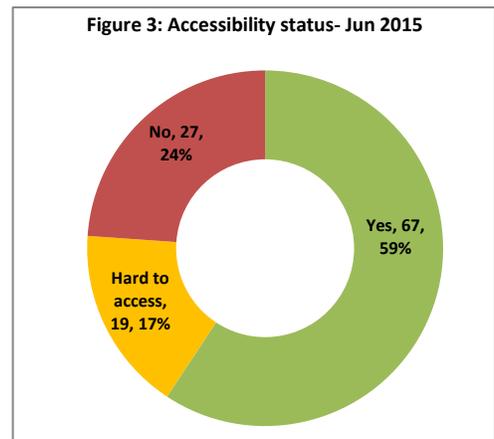


Map 2: Accessibility to public hospitals [MoH & MoHE], June 2015

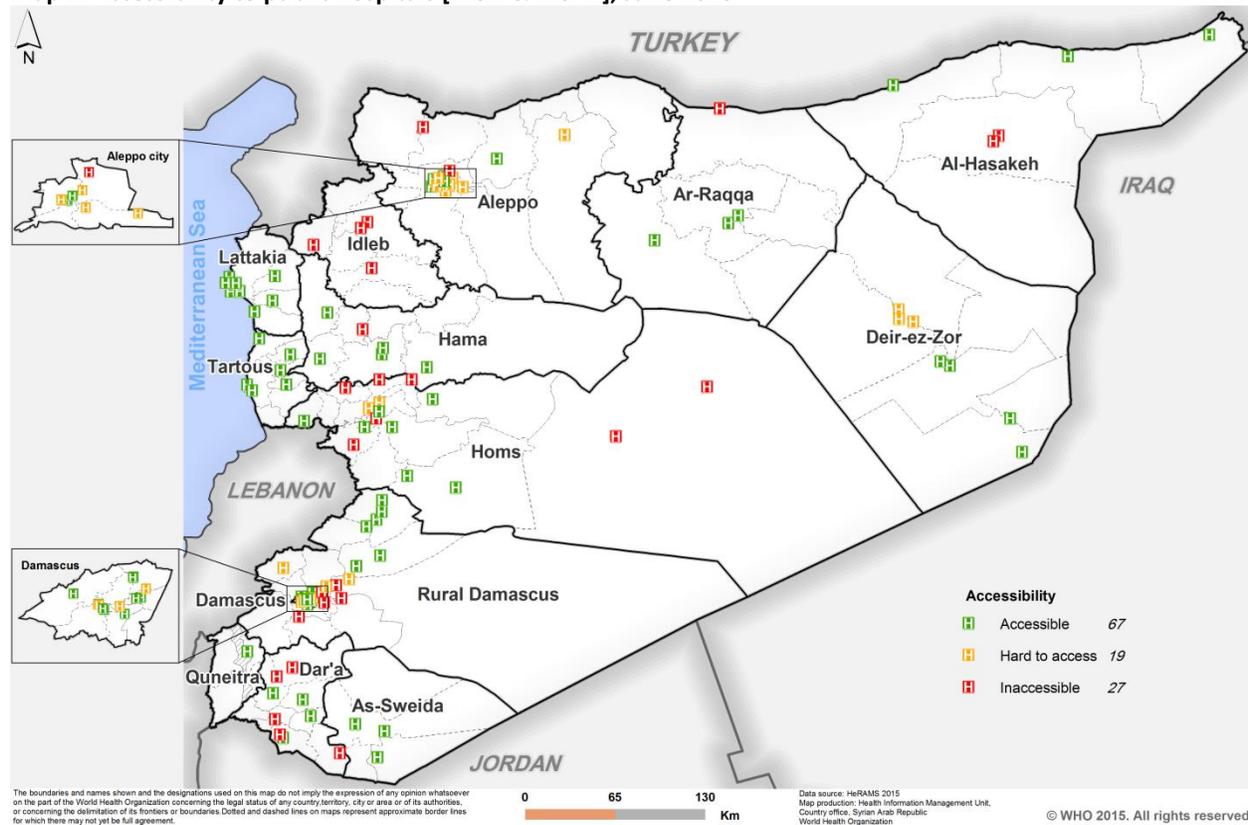

4. Level of Damage

The condition of the hospitals' buildings has been assessed at three levels: fully damaged, partially damaged, and not damaged.


By the end of June 2015, 42% (48) hospitals were reported damaged [12% fully damaged and 30% partially damaged], while 55% (62) of public hospitals were reported intact. The level of damage of three hospitals was unconfirmed due to escalating security situation: Tal Abyad hospital in Ar-Raqqa governorate, Al-Bassel-Tadmor and Al-Bassel-Sokhneh hospitals in Homs governorate [Figure 4]. Distribution of public hospitals by level of damage is presented in Map 3.

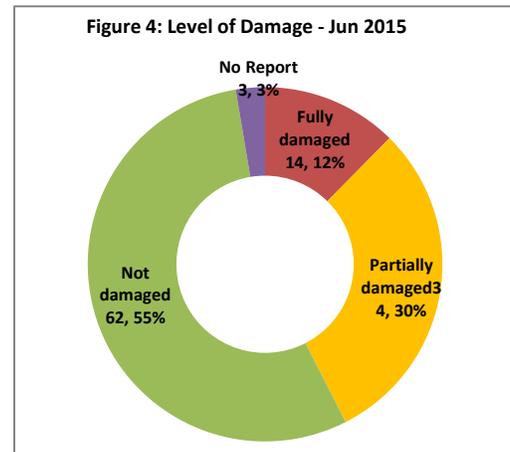


It is essential to cross-analyze the infrastructural damage of the public hospitals in relation to the functionality status (i.e. provision of services). Some hospitals have resiliently continued to provide services regardless of the level of damage of the building and by optimizing intact parts of the building or in a few cases operating from other neighboring facilities. The national figures translate as follows:

- Out of the **34 partially damaged hospitals**, 18 hospitals were reported partially functioning and 15 out of service (non-functioning), while one hospital (Yabroud, Rural Damascus) was reported to be fully functioning providing all services through salvaging medical equipment from the damaged section of the hospital with full staffing capacity.
- Out of the **14 fully damaged hospitals**, 10 were reported non-functioning while 4 hospitals have opted for innovative ways to continue providing health services to populations in need through partially functioning from other nearby temporary locations and provide health services with limited staff capacity and resources. *More details of the 4 hospitals are available in the HeRAMS database.*
- Then again, hospitals with **intact buildings (62 hospitals)** does not directly reflect full functionality, only 45 of the 62 intact hospitals are fully functioning, while 14 are partially functioning and 3 hospitals are not functioning all together, due to limited access of patients and health staff to the facilities resulting from the dire security situation as well as critical shortage of supplies.

Figure 5: Trend analysis of level of damage, between January and June 2015

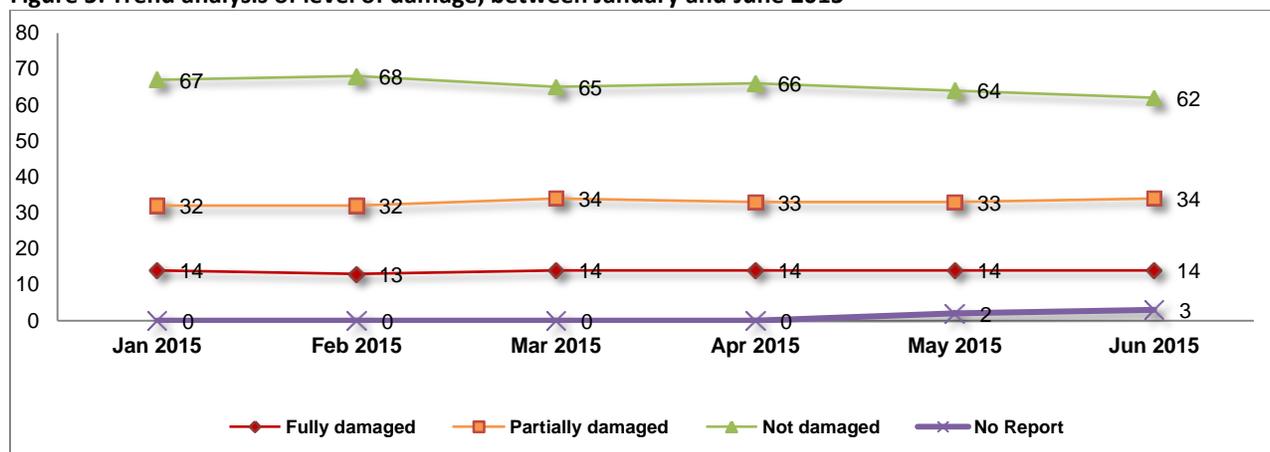

Map 3: Distribution and Level of damage of the public hospitals [MoH & MoHE], June 2015

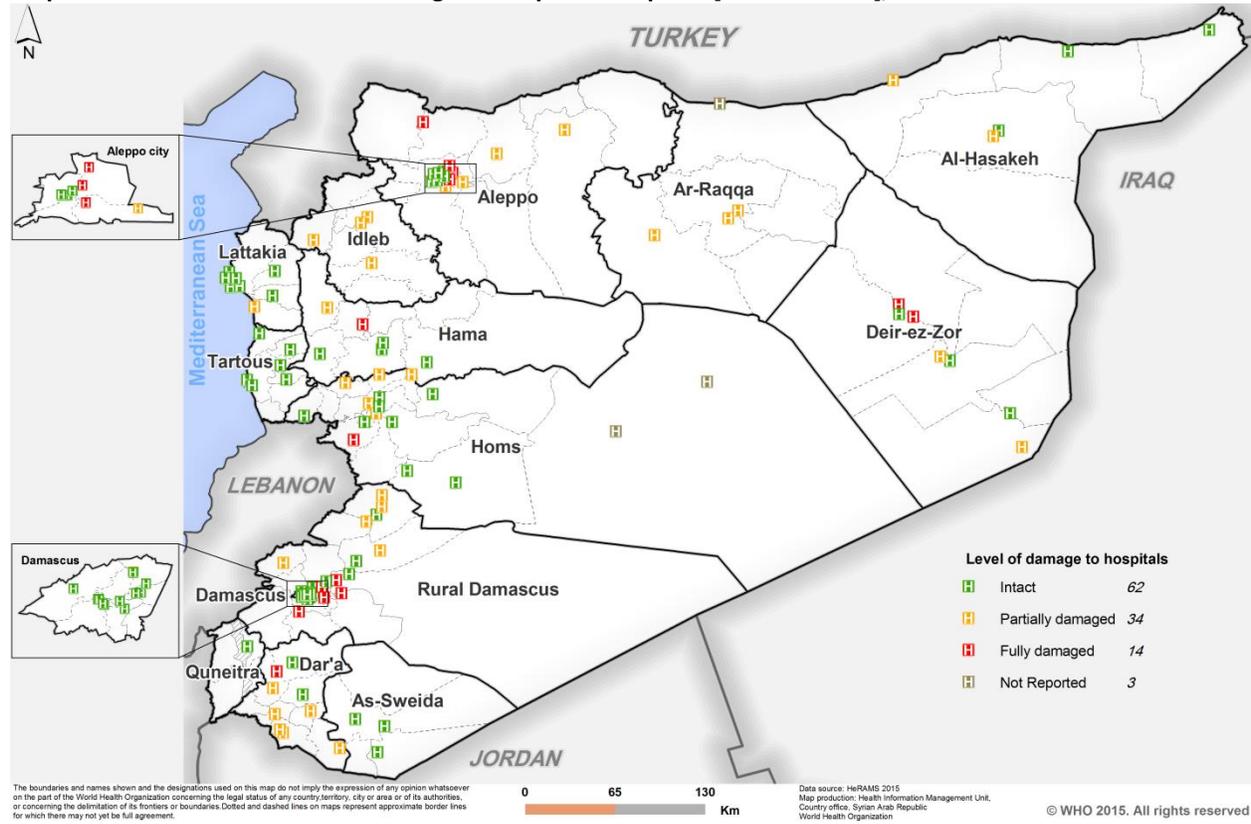

© World Health Organization 2015. All rights reserved. The designations employed and the presentation of the material in this publication do not imply the expression of any opinion whatsoever on the part of the World Health Organization concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries. Dotted lines on maps represent approximate border lines for which there may not yet be full agreement. The mention of specific companies or of certain manufacturers' products does not imply that they are endorsed or recommended by the World Health Organization in preference to others of a similar nature that are not mentioned. Errors and omissions excepted, the names of proprietary products are distinguished by initial capital letters. All reasonable precautions have been taken by the World Health Organization to verify the information contained in this publication. However, the published material is being distributed without warranty of any kind, either expressed or implied. The responsibility for the interpretation and use of the material lies with the reader. In no event shall the World Health Organization be liable for damages arising from its use.

WHO-EM/SYR/010/E